


Figure (Supplement). Consort Chart.

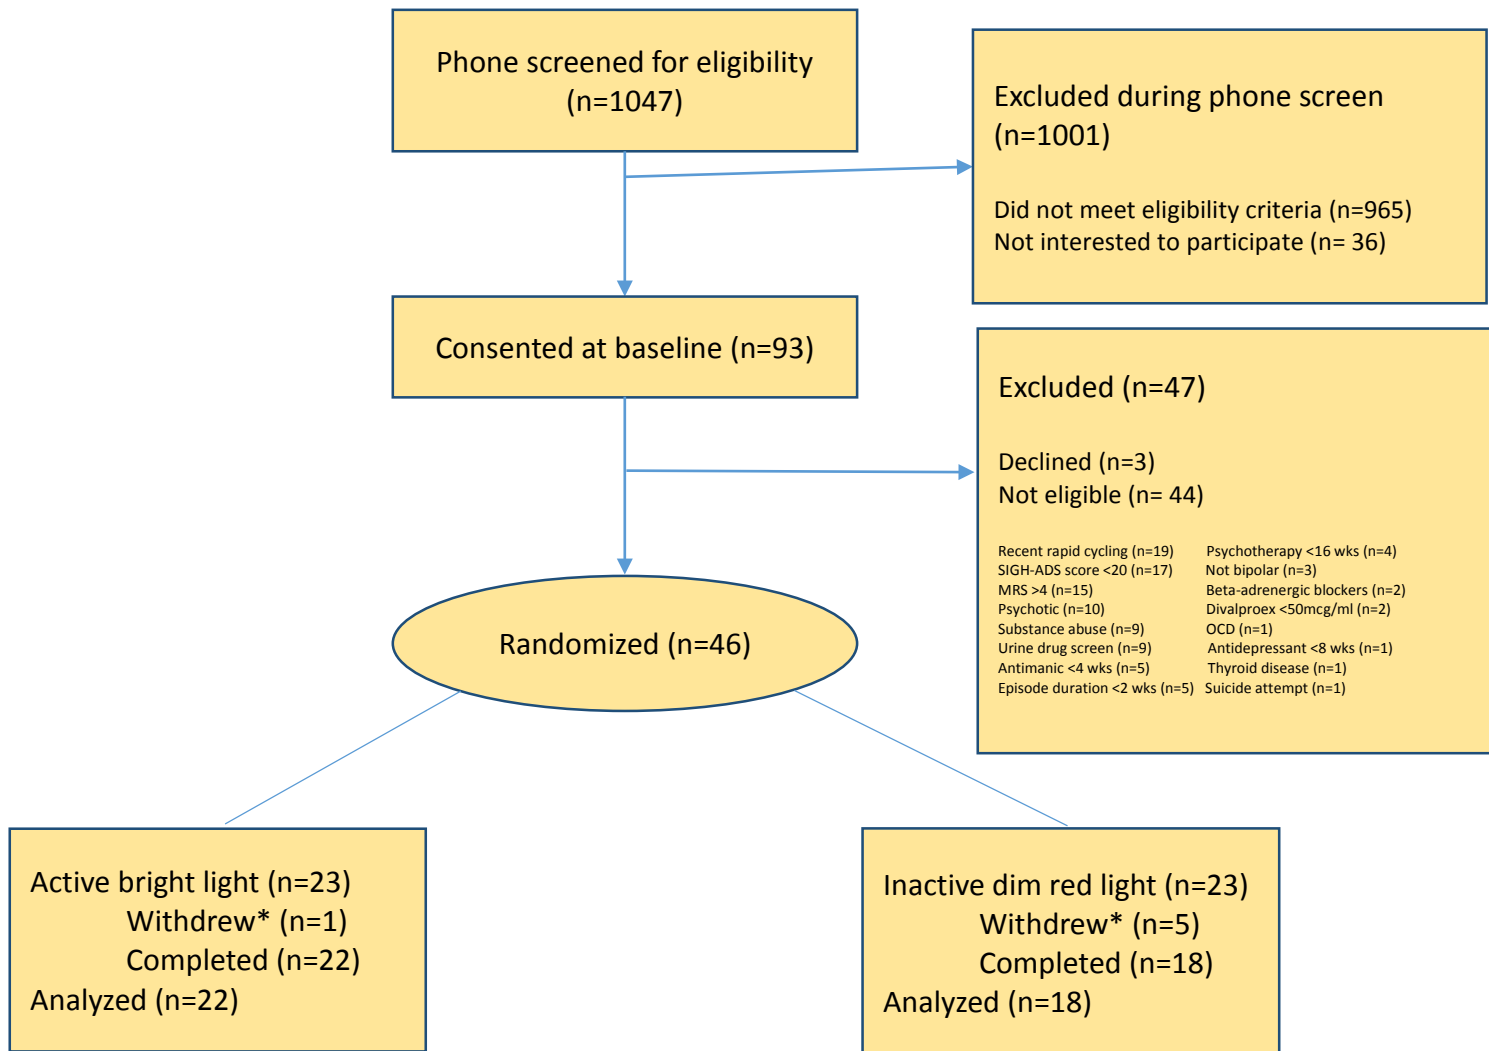

Note: Numbers based on primary outcome (SIGH-ADS).

All retained subjects were included in the analyses at each assessment point.

*See Results for the reasons for withdrawal.

DayLight 10000™ Output Spectrum

Biaxial Fluorescent at 3000 and 4000 deg K

